


BEFORE SETTING POLE, PLEASE CONTACT WFECA TO  
SPOT THE LOCATION OF THE POLE @ 1-800-342-7400 OR

Graceville 850-263-3231  
Sneads 850-593-6491  
Bonifay 850-547-9325

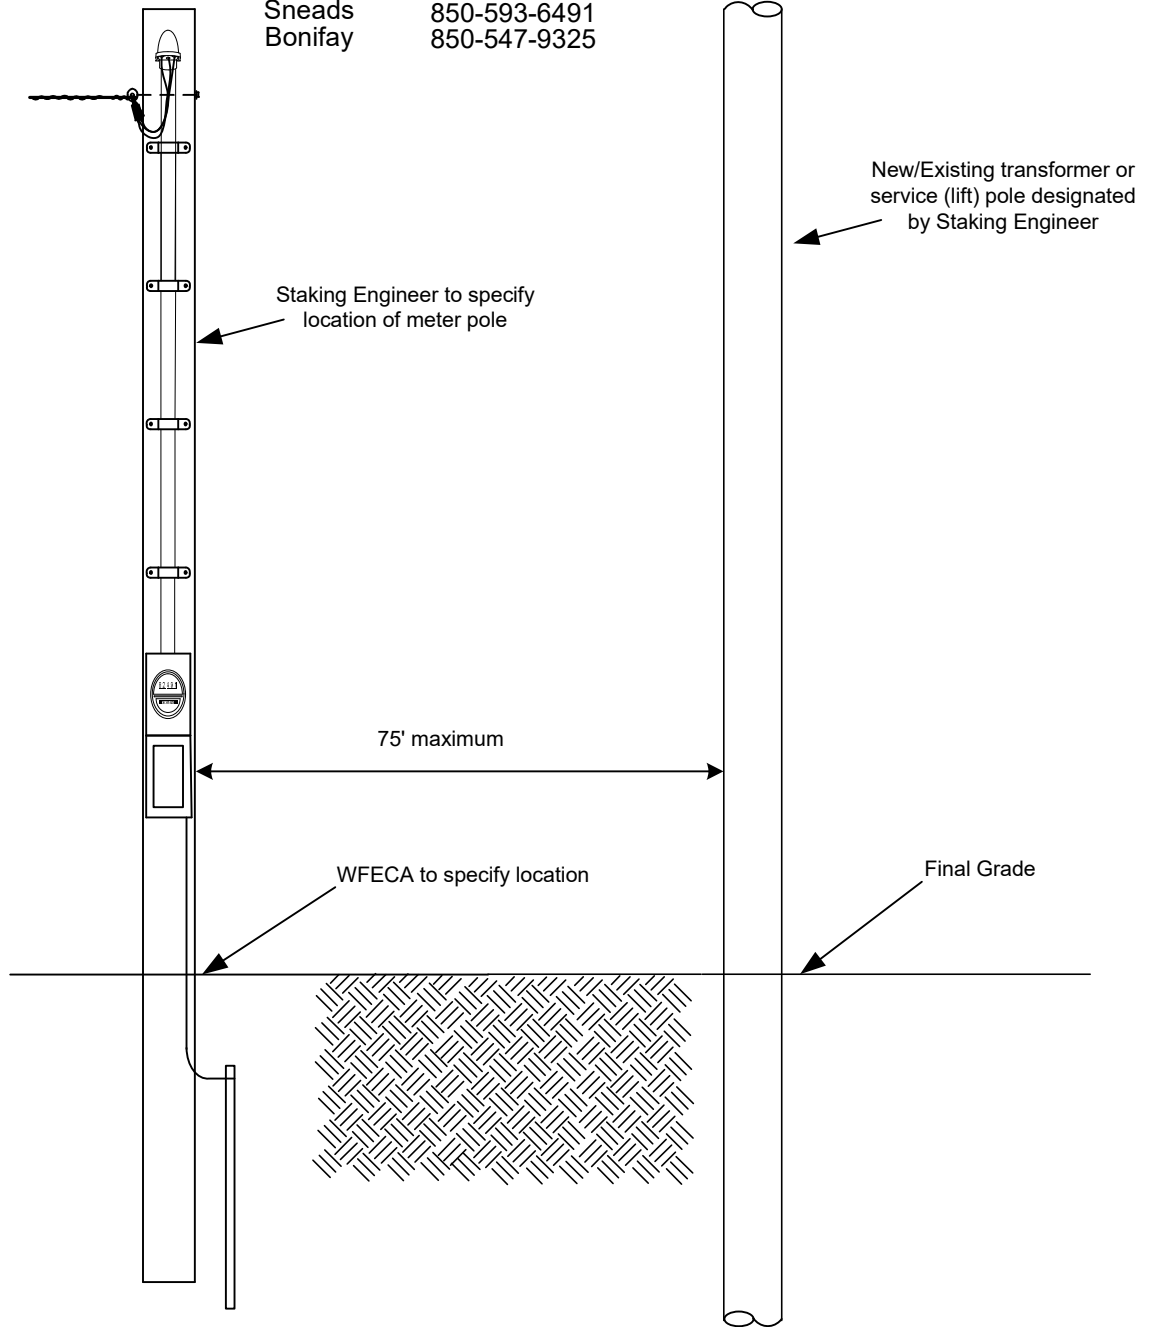

- Notes:
1. All Conduit is to be PVC Electrical Conduit, Schedule 40
  2. Customer furnishes and installs all material including meter base, pole and conductor from meter base to top of pole.
  3. WFECA will furnish and install conductor from pole to meter loop pole.
  4. WFECA will connect conductor to drip loop and transformer
  5. See Drawing GS4.0 for Construction Details.

**Disclaimer:** This document is intended as a guideline for overhead meter loop pole construction. Actual construction of meter loop pole services shall comply with the latest version of the National Electrical Code, the National Electrical Safety Code and any Federal, State, County or Municipal Codes, which ever is more stringent. Contact the Authority Having Jurisdiction (NEC 80.13) or its designated representative for specific details.

Guide for Location of Overhead Meter Loop Pole  
Used Exclusively for Construction

2021

WFECA

GS-4.1