


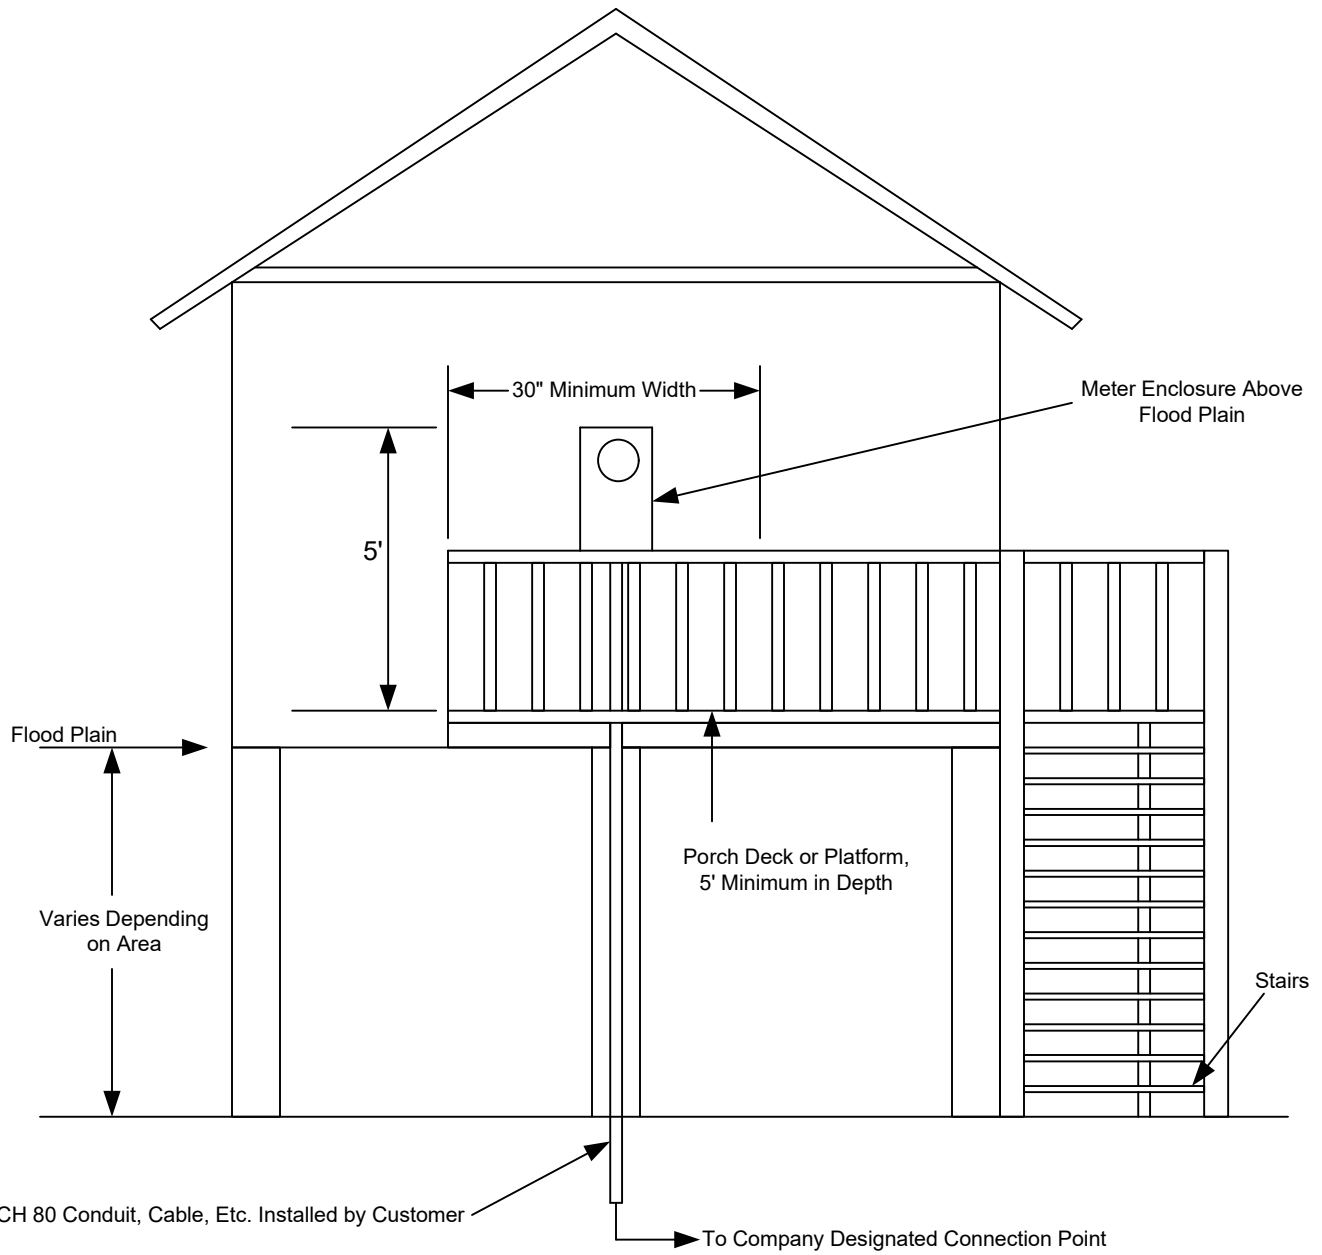

Notes:

PLATFORM 5' IN DEPTH IS ESTIMATED TO MEET 4' METER ENCLOSURE CLEARANCE REQUIREMENTS.
 ALL PLATFORM AND STAIR CONSTRUCTION SHALL BE PROVIDED BY THE CUSTOMER AND BUILT ACCORDING TO
 LOCAL BUILDING CODES.

Disclaimer: This document is intended as a guideline for underground meter loop construction.
 Actual construction of meter service shall comply with the latest version of the National Electrical
 Code, the National Electrical Safety Code and any Federal, State, County or Municipal Codes, which
 ever is more stringent. Contact the Authority Having Jurisdiction (NEC 80.13) or its designated
 representative for specific details.

**GUIDELINE FOR METER
 ENCLOSURE INSTALLATIONS
 IN FLOOD ZONES**

2021

WFECA

GS14.0