


BEFORE SETTING POLE, PLEASE CONTACT WFECA TO
SPOT THE LOCATION OF THE POLE @ 1-800-342-7400 OR

Graceville 850-263-3231
Sneads 850-593-6491
Bonifay 850-547-9325

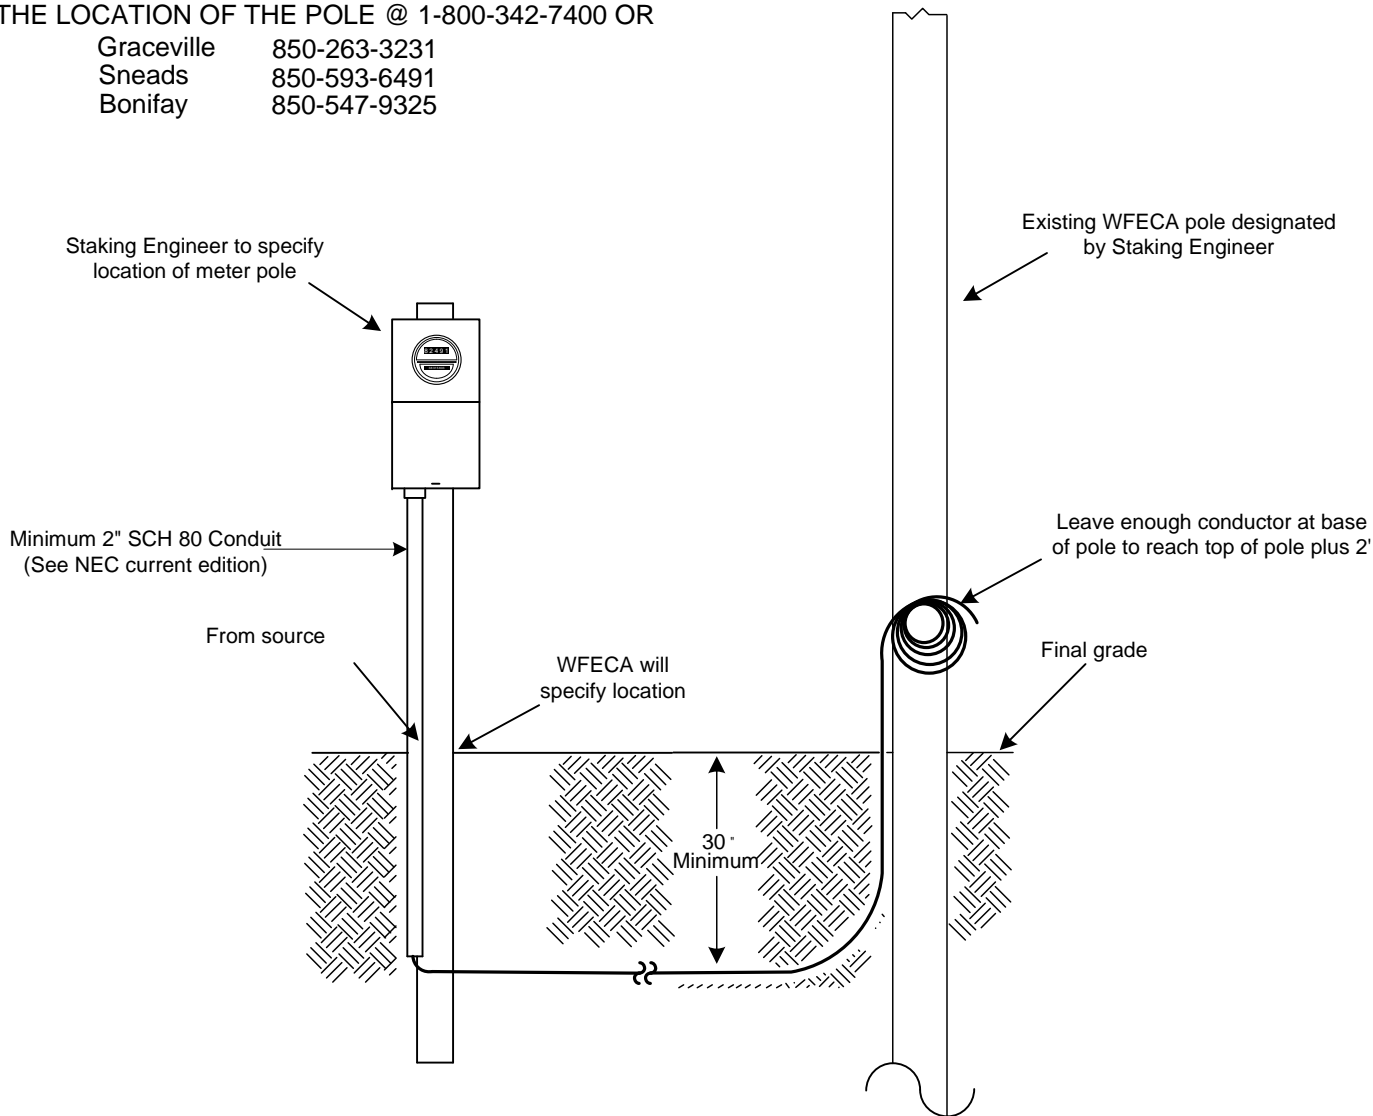

Notes:

1. All conduit is to be PVC electrical conduit, schedule 80
2. All Conductor below grade will be of the direct buried type.
3. Customer furnishes and installs all material, including underground meter base, pole, and conductor from the meter base transformer.
4. WFECA will furnish and install conduit and weatherhead up the transformer pole. Consumer will furnish conductor.
5. WFECA will connect conductor to transformer.
6. For all other details see (GS-5)
7. Consumer is responsible for sizing Conductor.

Disclaimer: This document is intended as a guideline for underground meter loop construction. Actual construction of meter service shall comply with the latest version of the National Electrical Code, the National Electrical Safety Code and any Federal, State, County or Municipal Codes, which ever is more stringent. Contact the Authority Having Jurisdiction (NEC 80.13) or its designated representative for specific details.

| | | |
|--|-------|--------|
| Guide for Location of Underground Meter Base Loop Pole (Used Exclusively for Construction) | | |
| 2013 | WFECA | GS-13A |