


BEFORE SETTING POLE, PLEASE CONTACT WFECA TO  
SPOT THE LOCATION OF THE POLE @ 1-800-342-7400 OR

Graceville 850-263-3231  
Sneads 850-593-6491  
Bonifay 850-547-9325

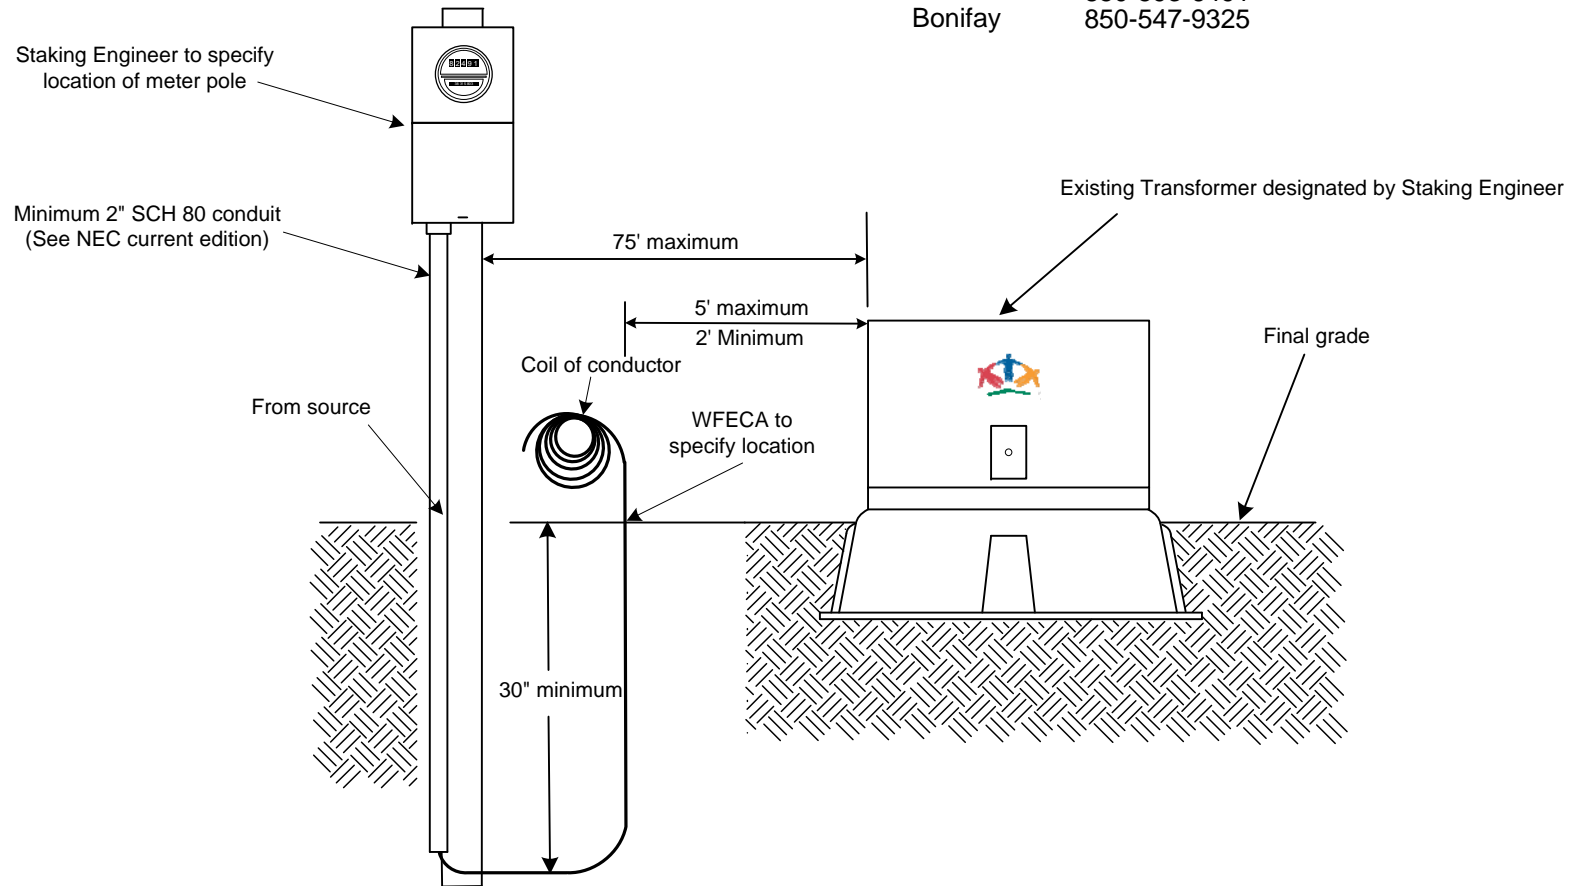

**Notes:**

1. All conduit is to be PVC Electrical Conduit, Schedule 80
2. All conductor below Grade will be of the Direct Buried Type.
3. Customer furnishes and installs all material, including underground meter base, pole, and conductor from the meter base to transformer.
4. WFECA will connect conductor to pad mount transformer, consumer will furnish conductor.
5. The minimum post size is 6" round or 4" square
6. For all other details see (GS-5)
7. Consumer is responsible for sizing Conductor.

**Disclaimer:** This document is intended as a guideline for underground meter loop construction. Actual construction of meter service shall comply with the latest version of the National Electrical Code, the National Electrical Safety Code and any Federal, State, County or Municipal Codes, which ever is more stringent. Contact the Authority Having Jurisdiction (NEC 80.13) or its designated representative for specific details.

Guide for Location of Underground Meter Base  
Loop Pole at Pad Mount Transformer  
**(Used Exclusively for Construction)**

2013	WFECA	GS-13B
------	-------	--------